


GENERAL NOTES:

1. VERIFY ALL MOUNTING HEIGHTS OF ELECTRICAL CONNECTIONS WITH EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN

KEYED NOTES:

- [illegible]

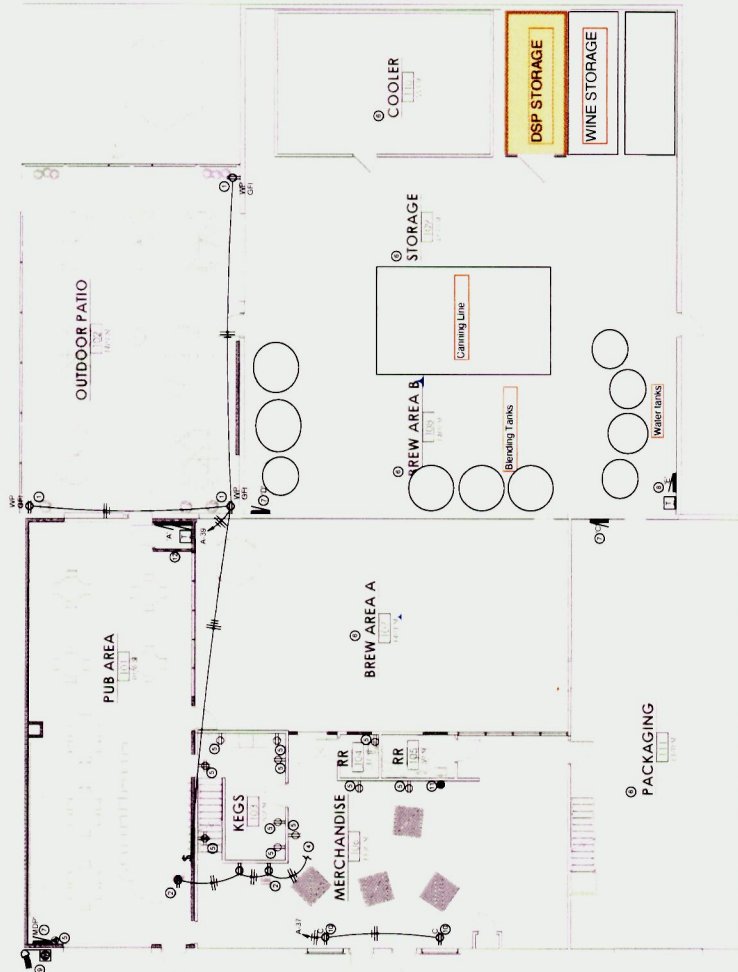

Premises ID 1A-279

RECEIVED

DEC 20 2023

IDAHO STATE POLICE
ALCOHOL BEVERAGE CONTROL