DIAGRAM / FLOOR PLAN

Premise ID 1A-14195

EXHIBIT 'A'

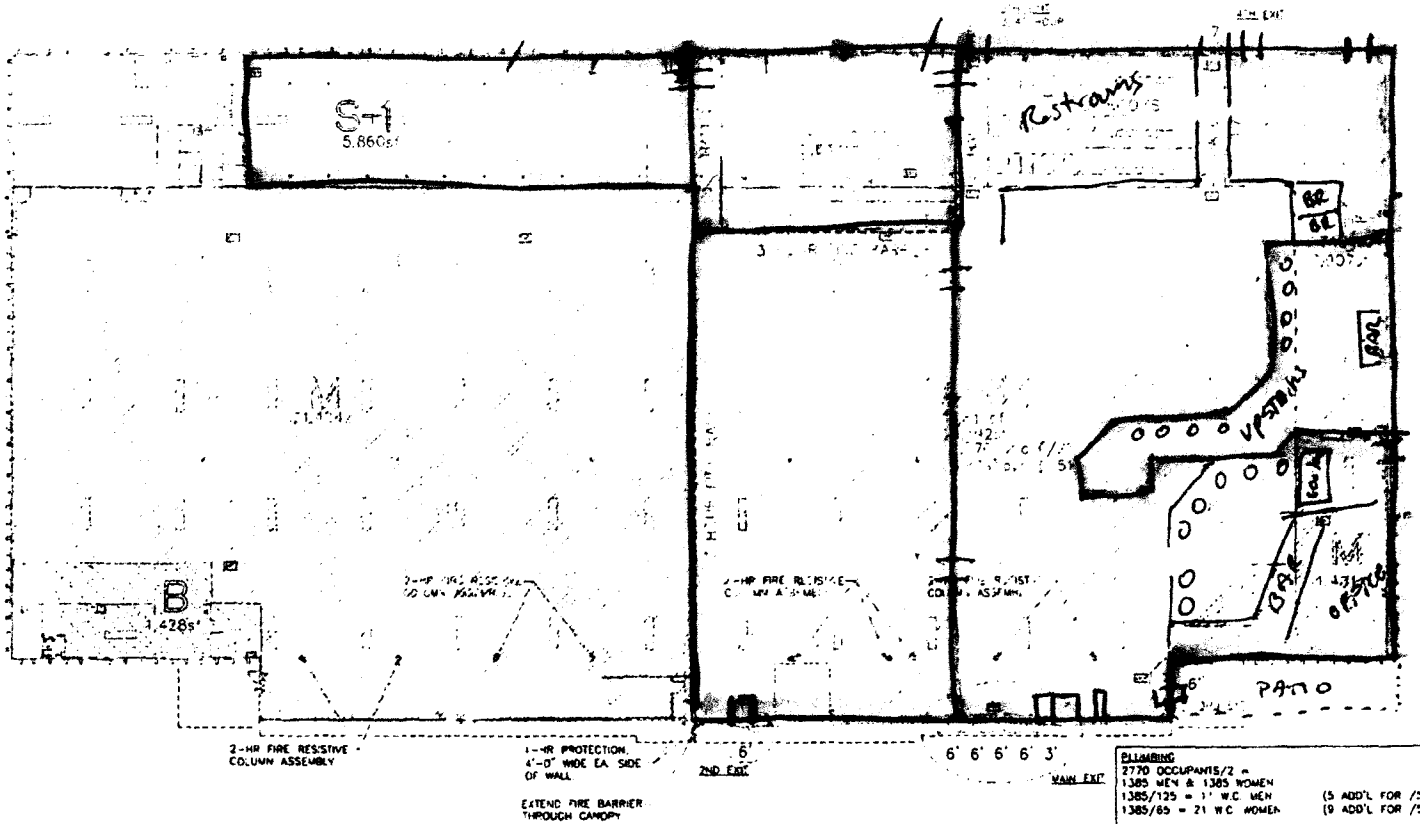

NO FIRE RATING REQUIRED FOR WALL BETWEEN A-3 & S-2
1-HR FIRE RATING REQUIRED FOR WALL BETWEEN A-3 & S-1
NO FIRE RATING REQUIRED FOR WALL BETWEEN M & S-1 OR S-2
1-HR FIRE RATING REQUIRED FOR WALL BETWEEN M & A-3
1-HR FIRE RATING REQUIRED FOR WALL BETWEEN S-1 & S-2
NO FIRE RATING REQUIRED FOR WALL BETWEEN B & M
NO FIRE RATING REQUIRED FOR WALL BETWEEN M & F-1
1-HR FIRE RATED OCCUPANCY DEMISING WALL

MIXED USE RATIO CALCS:

M	A3	F1	S2	B	S1
22,825 / 58,391	+ 21,817 / 44,337	+ 2,837 / 56,056	+ 2,907 / 121,454	+ 1,429 / 88,754	+ 5,860 / 81,748 =

0.391 + 0.492 + 0.047 + 0.024 + 0.016 + 0.072 = 1.0 (1.0 ALLOWED)

PLUMBING
2770 OCCUPANTS/2 =
1385 MEN & 1385 WOMEN
1385/125 = 11 W.C. MEN (5 ADD'L FOR /5)
1385/65 = 21 W.C. WOMEN (9 ADD'L FOR /5)

EGRESS WIDTH (4 EXITS REQ'D)
3879 OCC x .15 = 581.9 L.F.
581.9 / 12 = 48.5 L.F. EGRESS
50% @ MAIN ENTRY = 24.25 L.F. (27.0 L.F. PROV'D)
50% @ ALL OTHERS = 24.25 L.F. (25.0 L.F. PROV'D)

EXIT ACCESS
MAX LENGTH 250'-0"

COMMON PATH
MAX LENGTH 75'-0"

EXIT SEPARATION
1/3 DIAGONAL RULE

- AUDIBLE NOTIFICATION
- EMERGENCY STROBE
- ASSISTIVE LISTENING DEVICE

NORTH

MAIN LEVEL EGRESS PLAN (PROPOSED FOR C.U.P.)
SCALE: 1/8"=1'-0"

MAX BUILDING REVOVATION

EG

RECEIVED
MAR 15 2018
IDAHO STATE POLICE
ALCOHOL BEVERAGE CONTROL