


ONE HOUR FIRE RATED COMMON WALL

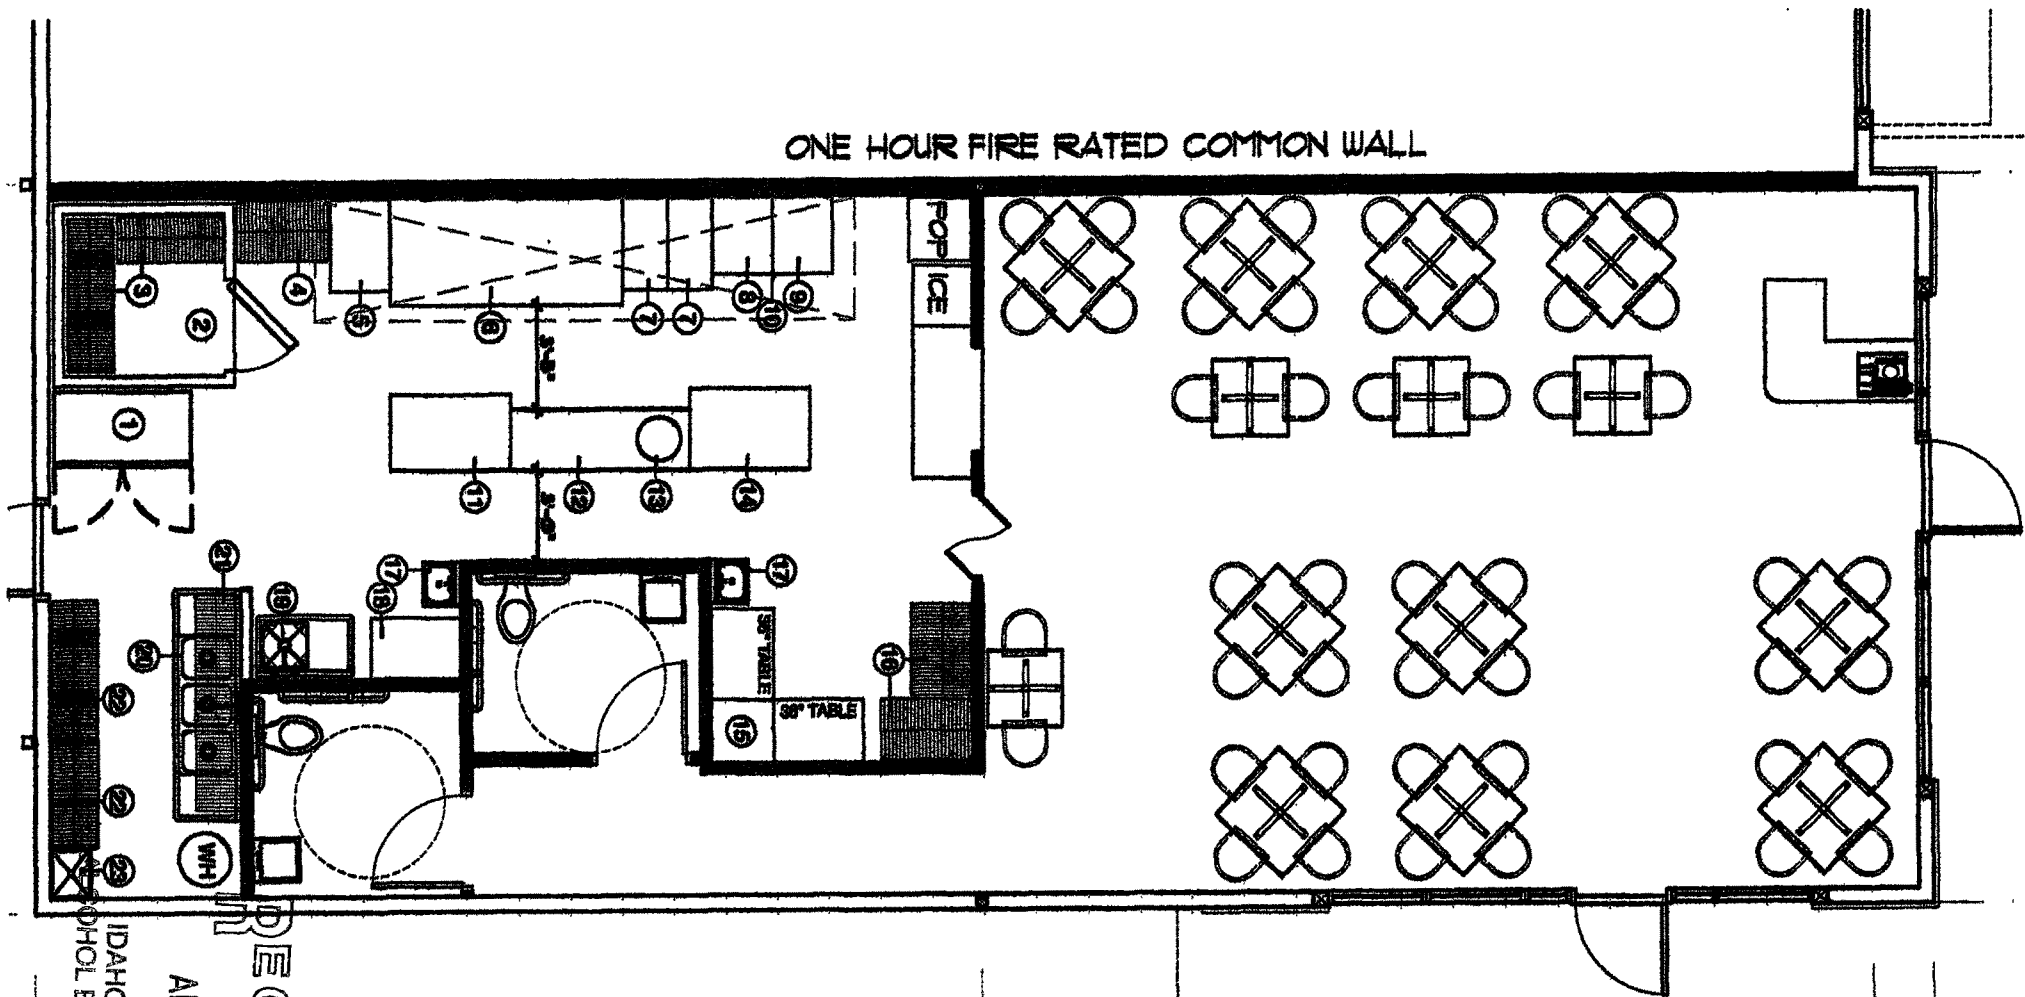

RECEIVED

APR 25 2017

IDAHO STATE POLICE
ALCOHOL BEVERAGE CONTROL